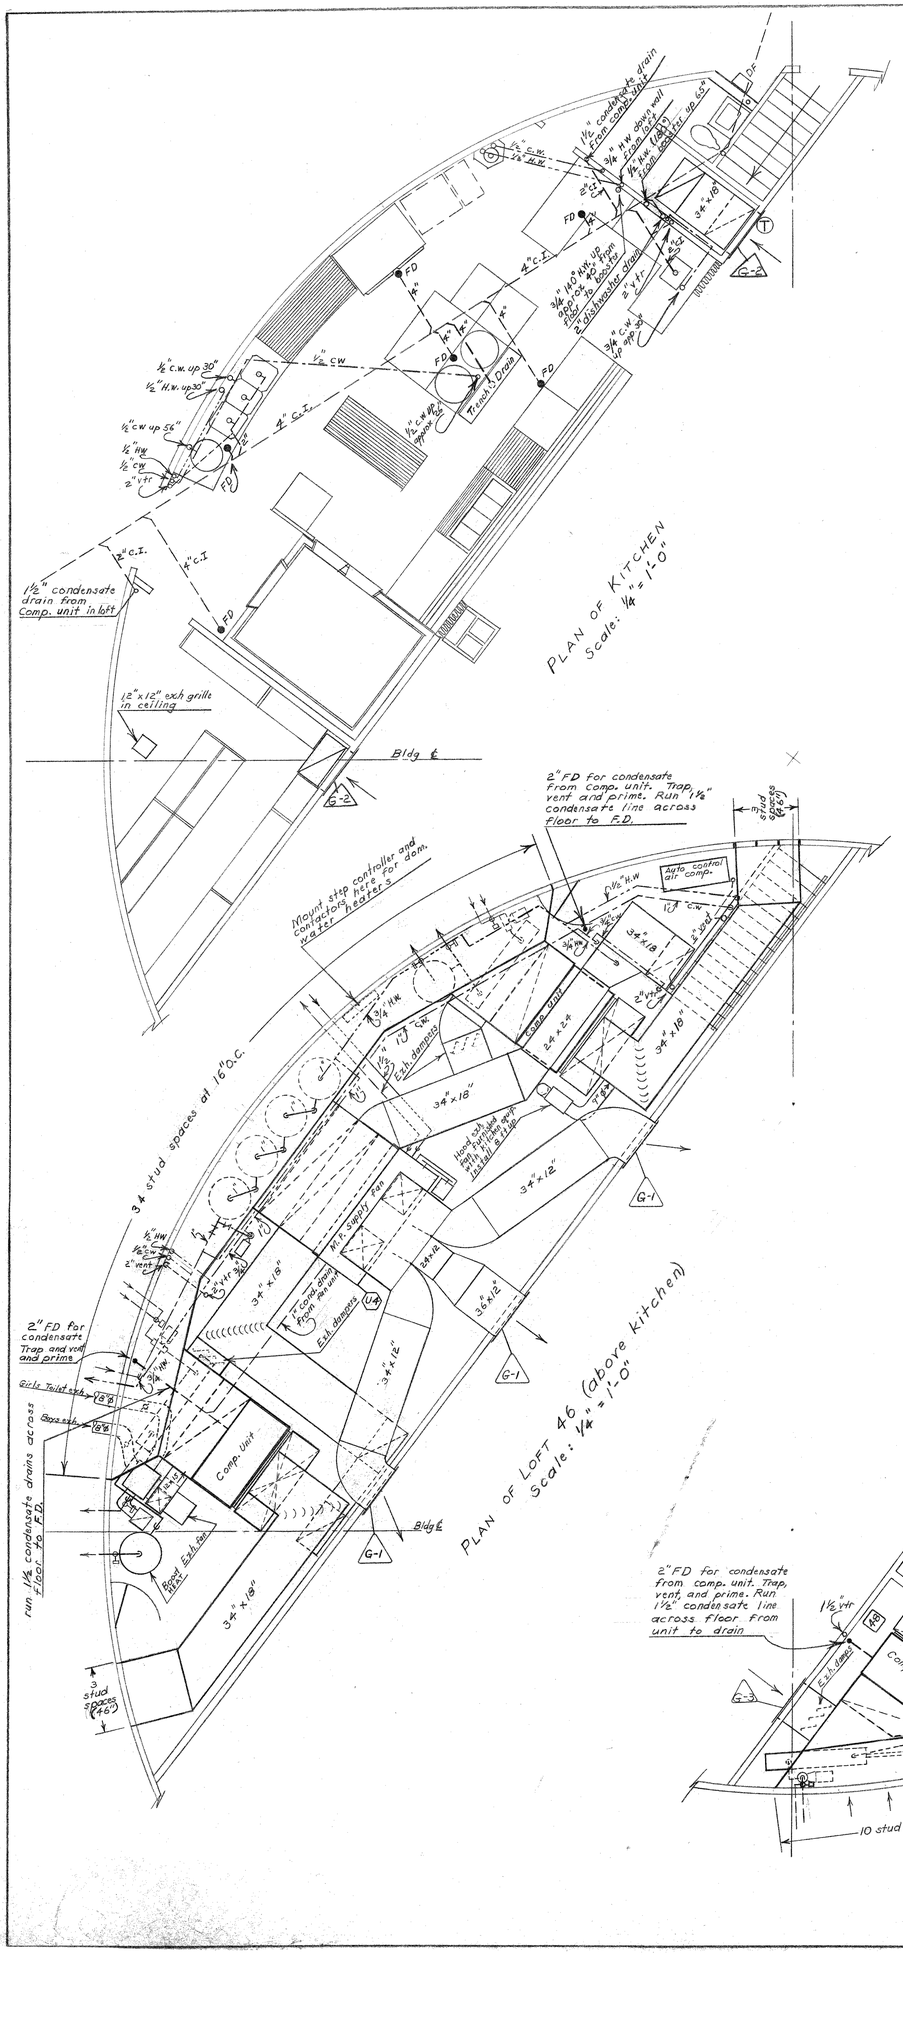

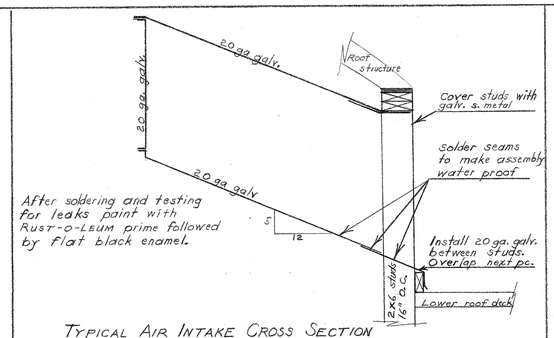

TYPICAL AIR INTAKE CROSS SECTION
Scale: 1" = 1'-0"

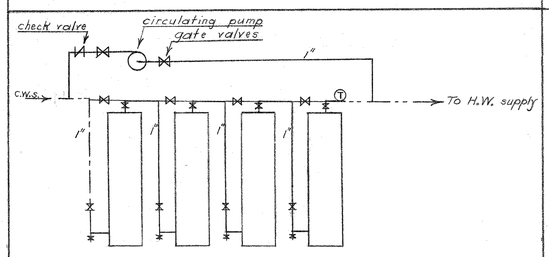

WATER HEATER PIPING DIAGRAM
Not to scale

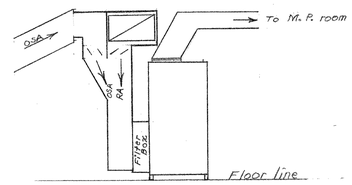

CROSS SECTION of M.P. Supply System
Scale: 1/4" = 1'-0"

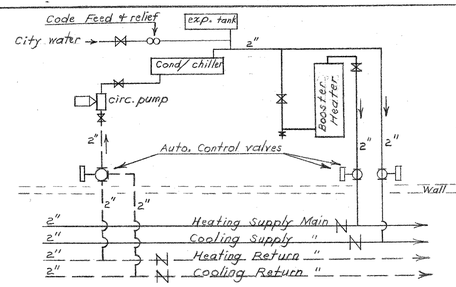

DIAGRAM of WATER PIPING in C.R. BLDG. COMP. ROOMS
Not to scale

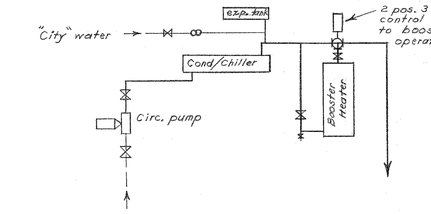

DIAGRAM of WATER PIPING in ADM. BLDG. COMP
Not to scale

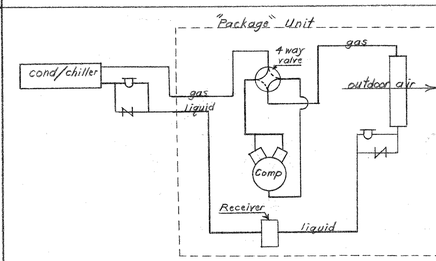

DIAGRAM of REFRIGERANT PIPING
Not to scale

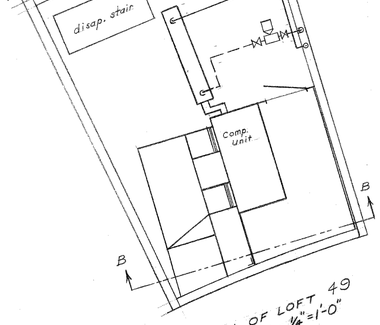

PLAN OF LOFT 49
Scale: 1/4" = 1'-0"

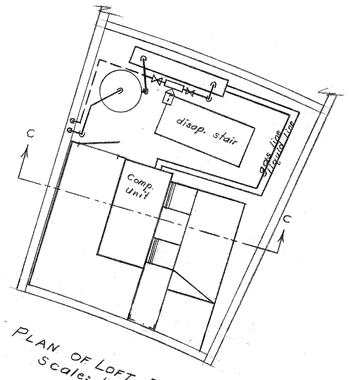

PLAN OF LOFT 50
Scale: 1/4" = 1'-0"



SECTION B-B
Scale: 1/4" = 1'-0"



SECTION C-C
Scale: 1/4" = 1'-0"

PLAN of LOFT 48, UPPER STAGE and LOFT 47
Scale: 1/4" = 1'-0"

REGISTERED PROFESSIONAL ENGINEER 3105 OREGON
Omer T. Jacobson
MAY 31, 1957
OMER T. JACOBSON

NEW SCHOOL FOR DISTRICT 1
Washington County Oregon
PLUMBING & HEATING
DETAILS
James C. Gardiner Architec
Omer T. Jacobson Engineer